

Instructions w/out fire panel

The following instructions appear on a separate sheet. Frame these instructions and place adjacent to the First responder panel for ready reference.


Local Service Representative

Name:

Address:

Phone:

This First responder panel interface is a full-function LOC or ACU. The First responder panel has a display and a sounder. The sounder distinct condition tones to alert you to alarm or trouble events as they occur. In conjunction with the display and the sounder, the status indicators provide the following system status information as described next.

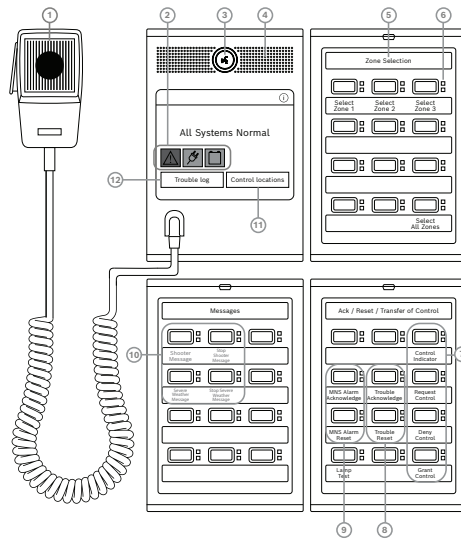

Operation

Normal operation

When in normal operation, the First responder panel LOC / ACU shows the idle text "All Systems Normal".

MNS (emergency) alarm operation

When an MNS alarm occurs, and the First responder panel emits a continuous tone. The tone sounds until the MNS Alarm Acknowledge button is pressed. The First responder panel indicates in which zones the automated message is playing. Acknowledge and silence the MNS alarm with the First responder panel extension buttons.

Trouble Operation

When a trouble condition occurs (such as wiring for a Loudspeaker line is cut or AC power fails), the First responder panel sounder activates briefly approximately every 5 seconds. The Trouble indicator lights on the display the trouble log shows the

active troubles. Press the Trouble Acknowledge button to acknowledge the trouble or navigate in to the trouble log to acknowledge the troubles.

Silence and Reset

To silence the alarm, use the First responder panel extension buttons.

Reset the PRAESENSA system with the MNS Alarm Reset button on the First responder panel.

Overview

1. Microphone + key:

- Live speech microphone: Active when the speak indicator (3) is steady on and by pressing the microphone key.
- To activate the call: First make a zone / zone group (5) selection before pressing the key.

2. Indicator:

- Trouble indicator: Yellow is trouble.
- Mains availability: Green is available/ok.
- Battery status: Green is ok.

3. Speak indicator:

- Flashing: Please wait to speak.
- Steady: Speak now.

4. Sounder:

Generates Alarm or Trouble sounds and tones.

5. Zone / Zone group buttons:

Select to start live announcement/paging.

6. Zone status indicators:

- Loudspeaker icon Red: Alarm message playing in zone.

- Loudspeaker icon Blue: Low priority call playing in zone.

- Warning triangle Yellow: Trouble exist in this zone.

7. Transfer of Control: Control indicator:

- White button ring lit: The First responder panel is in control.
- White button ring off: Control must be requested first, before First responder panel can be operated.
- To Request Control: Press Request Control.
- To Deny Control: Press blinking Deny Control button.
- To Grant Control: Press blinking Grant Control button.
- At ACU: Control can be forced by pressing and holding the button related to the Control Indicator for two seconds.

8. Trouble Acknowledge:

Silences the Trouble buzzers of the PRAESENSA First responder panels.

Trouble Reset: Reset a Trouble indication after a Trouble condition has been resolved.

9. MNS Alarm Acknowledge:

Silences the Emergency buzzer of the PRAESENSA First responder panels. It does not silence the audio zones.

MNS Alarm Reset: Indication of the system in Mass Notification Alarm condition. Sets the system to Normal operation after all MNS alarms are stopped and resolved.

10. Start and stop of alarm messages:

- Loudspeaker icon Red on: Alarm message active.
- Loudspeaker icon Red blinking: Alarm message active, but possibly not reaching all zones.
- White button ring lit: Alarm started from FRP.

11. Control locations button:


Shows all control locations, and which location is currently in control of the system.

12. Trouble log button:

Access to detailed trouble log.

PRAESENSA

PRA-FRP3-US | PRA-FRP3-USNY



en Operating instructions without use of fire panel

Bosch Security Systems B.V.

Torenallee 49

5617 BA Eindhoven

Netherlands

www.boschsecurity.com

© Bosch Security Systems B.V., 2024

Building solutions for a better life